



Retail Building




Region	south
Age Class	1995-2001
Net leased area [m²]	6835.1
Bldg Height [m]	7.0
Storeys a.g.	1.4
Storeys b.g.	0.9



Building Performance (KPIs)

KPI	Mean	95% CI	Unit	CV	n _{Sim}
Final heat energy demand - per year	504950.97	± 18156.48	kWh/a	0.72	810
Final heat energy demand - per m² net leased area and year	74.15	± 0.59	kWh/m²a	0.16	810
Carbon footprint (GWP) from heat energy - per year	126158.96	± 4536.29	kgCO ₂ eq,B6/a	0.72	810
Carbon footprint (GWP) from heat energy - per m² net leased area and year	18.52	± 0.15	kgCO ₂ eq,B6/m²a	0.16	810
Life Cycle Carbon footprint (GWP) - over 50 years	7465621.91	± 269079.47	kgCO ₂ eq,full/50a	0.73	810
Life Cycle Carbon footprint (GWP) - per m² net leased area and for 50 years	1095.62	± 8.95	kgCO ₂ eq,full/m²50a	0.16	810

Local Climate Influence




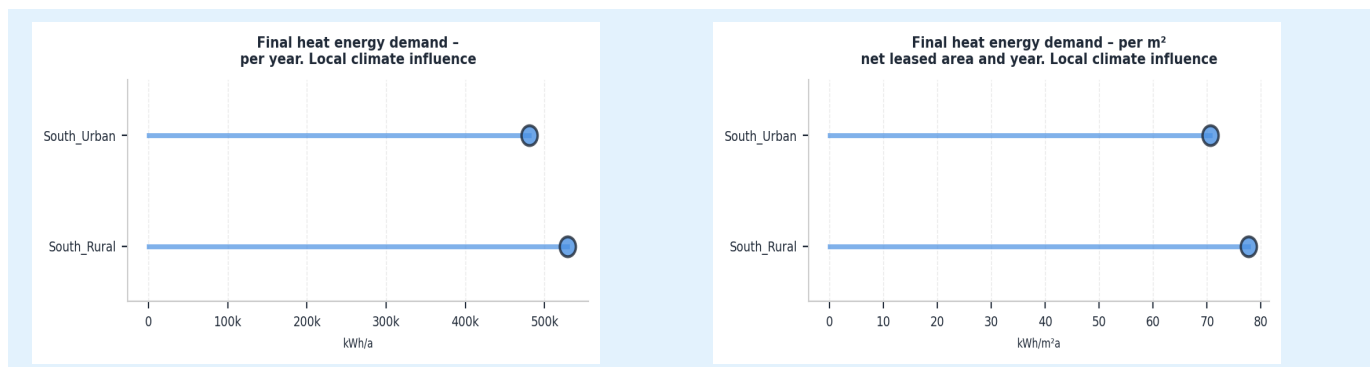




Retail Building




Region	south
Age Class	1995-2001
Net leased area [m²]	6835.1
Bldg Height [m]	7.0
Storeys a.g.	1.4
Storeys b.g.	0.9

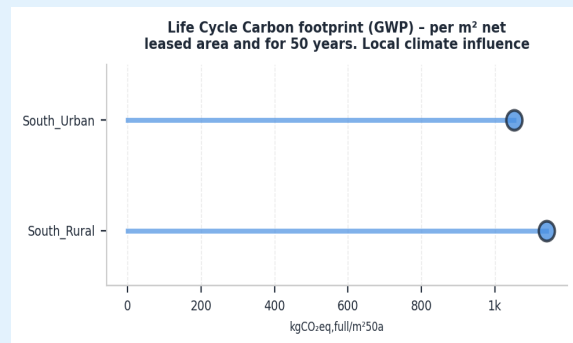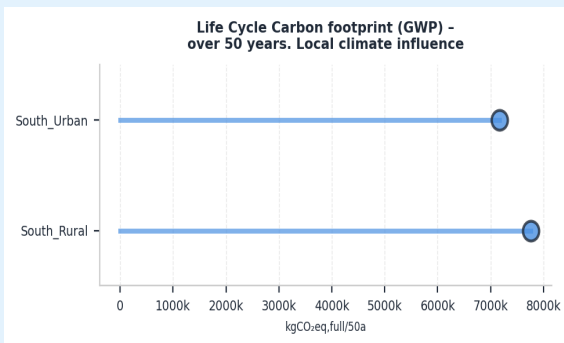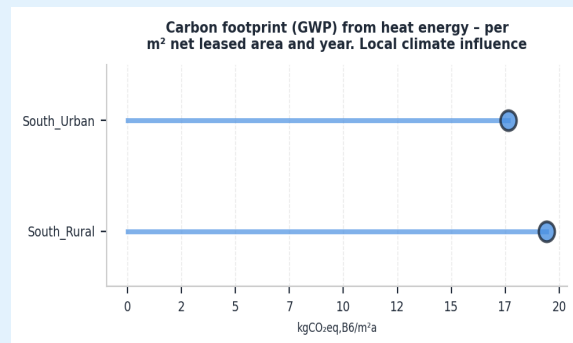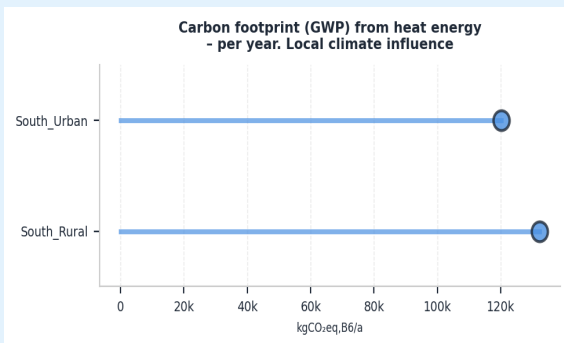

Mean Life Cycle GWP

ABC

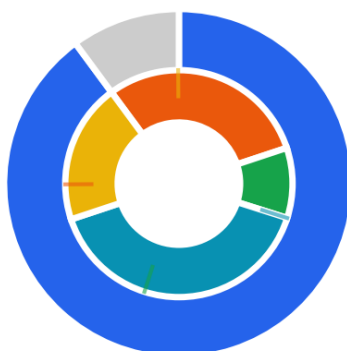

- Operational (89.0%)
- Exterior walls (3.00%)
- Roof (1.00%)
- Foundation (4.00%)
- Windows (2.00%)

Building element	D [kgCO ₂ eq/50a]
Exterior walls	5,031
Roof	1,819
Foundation	-4,361
Windows	-30,478






Retail Building

Region	south
Age Class	1995-2001
Net leased area [m ²]	6835.1
Bldg Height [m]	7.0
Storeys a.g.	1.4
Storeys b.g.	0.9



Building Performance

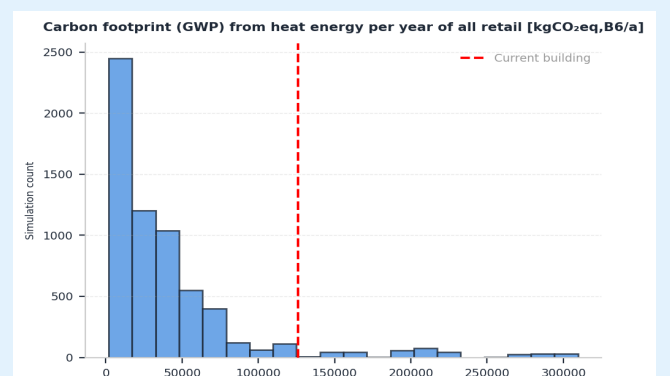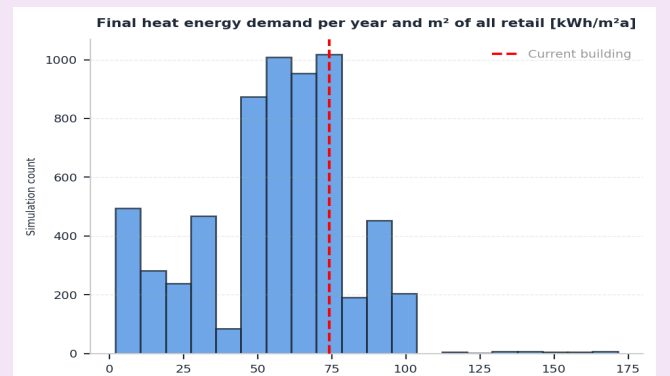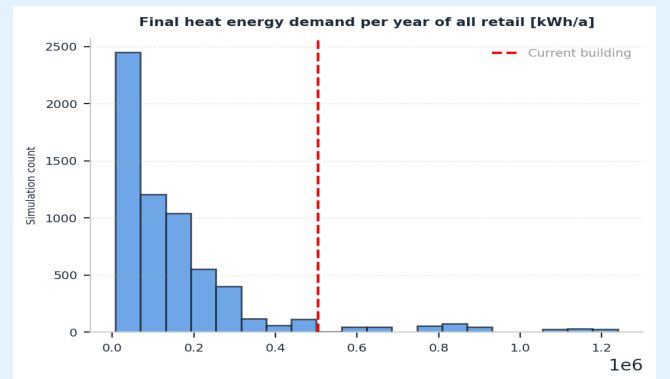







Retail Building

Region	south
Age Class	1995-2001
Net leased area [m²]	6835.1
Bldg Height [m]	7.0
Storeys a.g.	1.4
Storeys b.g.	0.9



Building Performance

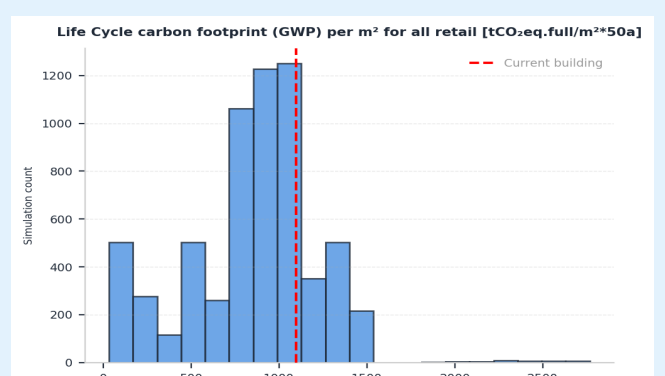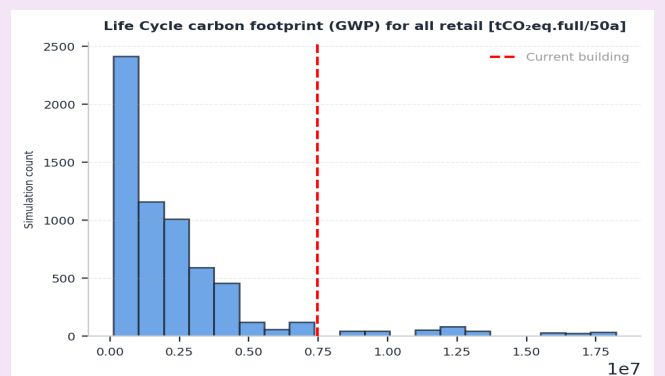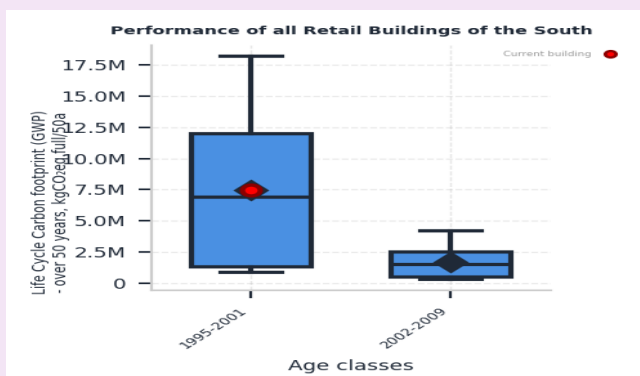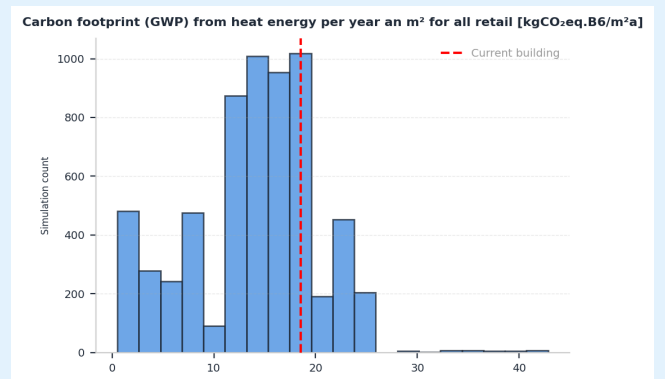



Retail Building



Region	south
Age Class	1995-2001
Net leased area [m²]	6835.1
Bldg Height [m]	7.0
Storeys a.g.	1.4
Storeys b.g.	0.9



Exterior Wall

Type: massive

U [W/m²K]: 0.56

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	interior plaster	1	1400	0.7	850	5	-
1	reinforced concrete	22	2400	2.1	776	6	-
2	mineral wool	5.74	60	0.04	850	3	-
3	concrete	6	2400	2.1	776	6	-
4	exterior plaster	2	1800	0.87	850	1	-

Interior Wall

U [W/m²K]: 4.04

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	lime plaster	1	1600	0.7	850	5	-
1	reinforced concrete	10	2100	2.04	776	6	-
2	lime plaster	1	1600	0.7	850	3	-

Roof

U [W/m²K]: 0.31

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	concrete_CEM_II_B S325R_wz05	22	2420	2.1	1000	6	-
1	styrofoam	10	30	0.035	1500	10	-
2	gravel	3	750	0.19	920	7	-



Retail Building



Region	south
Age Class	1995-2001
Net leased area [m²]	6835.1
Bldg Height [m]	7.0
Storeys a.g.	1.4
Storeys b.g.	0.9



Foundation

U [W/m²K]: 0.35

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	floating cement screed	4	1940	1.4	1000	11	-
1	EPS_040_15	10	15	0.04	1500	2	-
2	concrete_CEM_II_B S325R_wz05	22.8	2420	2.1	1000	6	-

Floor

U [W/m²K]: 4.04

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	floating cement screed	4	1940	1.4	1000	11	-
1	EPS_040_15	6	15	0.04	1500	2	-
2	reinforced concrete	22.8	2104	1.94	776	6	-

Window System

Glazing	EPD _{Gl}	Frame type	EPD _{Fr}	Shading type	EPD _{Sh}
2	9	aluminium	8	-	-

Heating System

Unit type	Generator	EPD _{HEG}	Heating energy carrier	EPD _{HEC}
per_bldg	boiler_gas_large_condensing	12	gas	4



Retail Building



Region	south
Age Class	1995-2001
Net leased area [m²]	6835.1
Bldg Height [m]	7.0
Storeys a.g.	1.4
Storeys b.g.	0.9




Façade length [m]							
N		S		E		W	
Mean	SE	Mean	SE	Mean	SE	Mean	SE
51.14	26.72	53.65	29	48.1	14.65	47.42	13.38

Façade area [m²]							
N		S		E		W	
Mean	SE	Mean	SE	Mean	SE	Mean	SE
509.97	346.18	541.73	377.13	440.43	199.79	426.18	182.38

EPD Summary Table

Serial No.	Full UUID	Material Name
1	004f3f4e-5bb8-4d9e-a104-6999a9e8ad5b	Gypsum lime plaster
2	205b761d-e344-49c3-a3a9-bb1bfd59b916	Expanded Polystyrene (EPS) Foam Insulation (density 15 kg/m³)
3	50d421e2-3a7b-4659-92a4-f20d6a52fcf0	Mineral wool (facade insulation)
4	84aa7483-9824-49a9-a3e3-f9fb092ea7b7	Use - 1 kWh of final energy from gas calorific value (according to GEG)
5	9a670d29-efb9-4fde-95ab-182a0b1e7280	Lime gypsum interior plaster
6	Synthetic_2	Concrete C30/37 with reinforcement steel
7	a7bad3b6-2123-483b-99b5-2ec481254be7	Gravel 2/32 (dried)
8	d0e0f205-2f4d-4c7f-b63a-23a9abd6e60a	Aluminium frame profile, powder coated
9	dcf38066-e336-46a7-b0a8-b2453dd2872d	Window glass, single
10	f2552bdf-c847-4ef8-9665-c37e8ef4d44d	Polystyrene foam filling (without binder)
11	fe371be5-c72f-4203-8569-a085ef375ba4	CALCIUM SULPHATE FLOWING SCREED AND CONVENTIONAL CALCIUM SULPHATE SCREED
12	fe91b985-60da-45dc-b3fd-29b9e632d49f	Gas condensing boiler120-400 kW (upright unit)

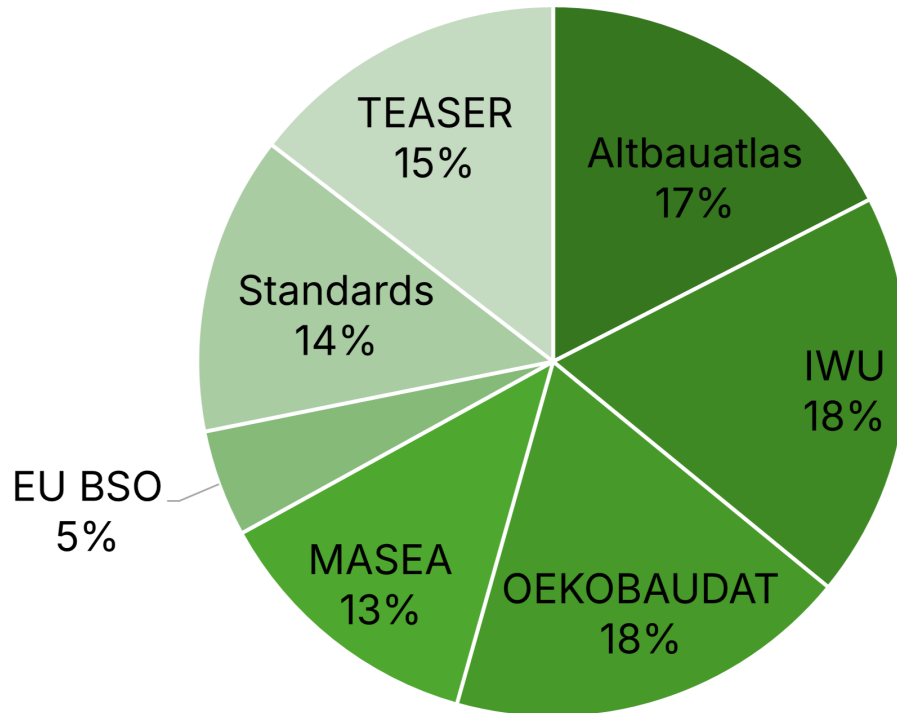

Data source	Link
Altbauatlas	https://www.altbauatlas.de/index.php
OEKOBAUDAT	https://www.oekobaudat.de/en.html
IWU	https://datenbasis.iwu.de/ https://wohngebaeuedaten2016.iwu.de/
MASEA	https://www.masea-ensan.de/
TEASER	https://ebc-tools.eonerc.rwth-aachen.de/en/teaser
EU BSO	https://building-stock-observatory.energy.ec.europa.eu/database/

* Building images are generated by AI