



Hospitality Building





Net leased area [m²]	1688.0
Bldg Height [m]	9.0
Storeys a.g.	2.2
Storeys b.g.	0.5



Building Performance (KPIs)

KPI	Mean	95% CI	Unit	CV	n _{Sim}
Final heat energy demand - per year	67247.37	± 1266.33	kWh/a	0.49	3240
Final heat energy demand - per m² net leased area and year	40.22	± 0.46	kWh/m²a	0.34	3240
Carbon footprint (GWP) from heat energy - per year	16837.83	± 315.12	kgCO ₂ eq,B6/a	0.49	3240
Carbon footprint (GWP) from heat energy - per m² net leased area and year	10.07	± 0.11	kgCO ₂ eq,B6/m²a	0.34	3240
Life Cycle Carbon footprint (GWP) - over 50 years	1187990.70	± 22859.51	kgCO ₂ eq,full/50a	0.51	3240
Life Cycle Carbon footprint (GWP) - per m² net leased area and for 50 years	709.40	± 8.20	kgCO ₂ eq,full/m²50a	0.36	3240

Local Climate Influence



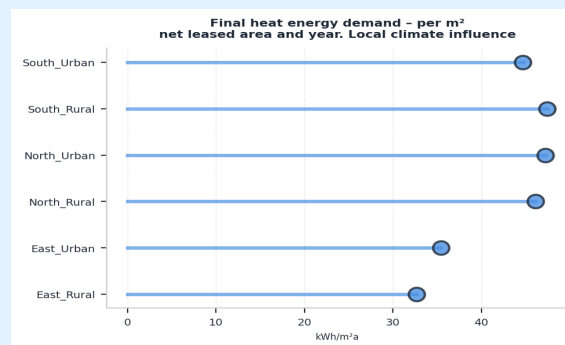
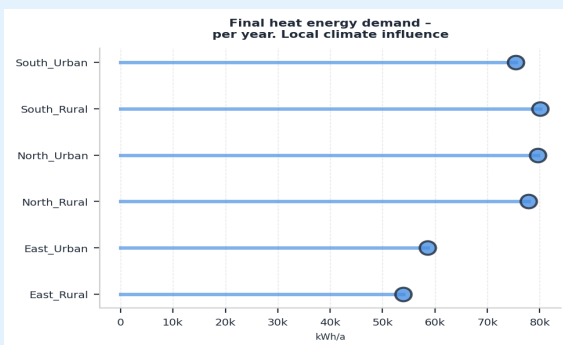




Hospitality Building




Net leased area [m²]	1688.0
Bldg Height [m]	9.0
Storeys a.g.	2.2
Storeys b.g.	0.5

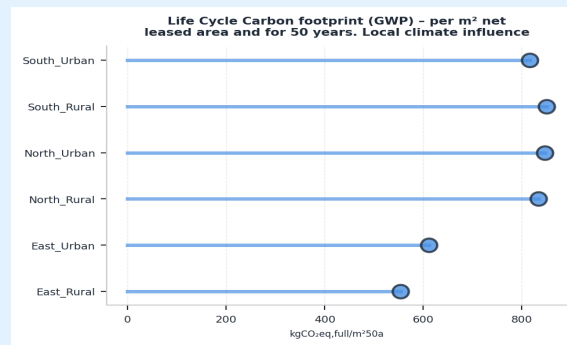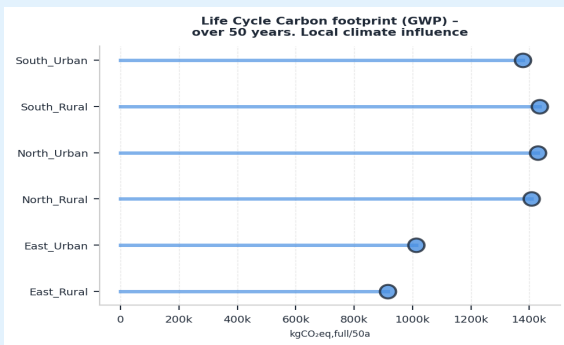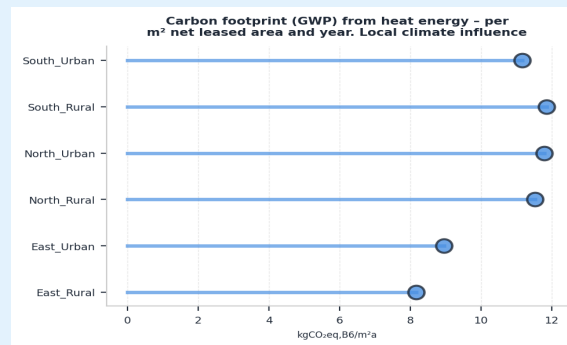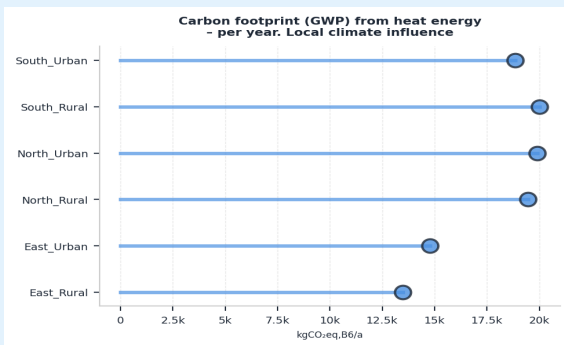

Mean Life Cycle GWP

ABC

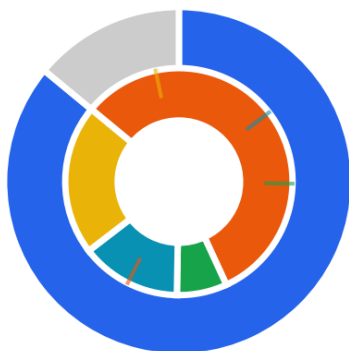

- Operational (86.0%)
- Exterior walls (8.00%)
- Roof (1.00%)
- Foundation (2.00%)
- Windows (3.00%)

Building element	D [kgCO ₂ eq/50a]
Exterior walls	1,798
Roof	-653.8
Foundation	442.5
Windows	-3,955






Hospitality Building



Net leased area [m ²]	1688.0
Bldg Height [m]	9.0
Storeys a.g.	2.2
Storeys b.g.	0.5



Building Performance

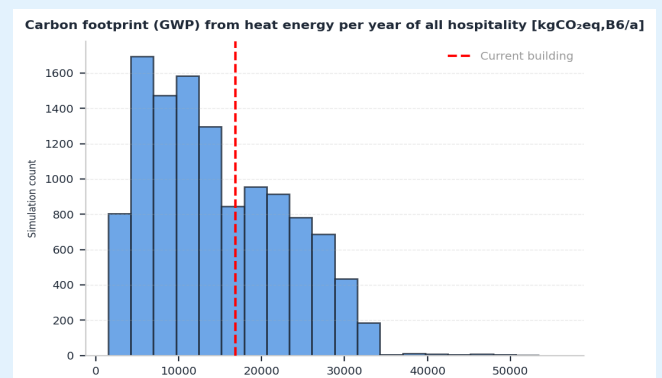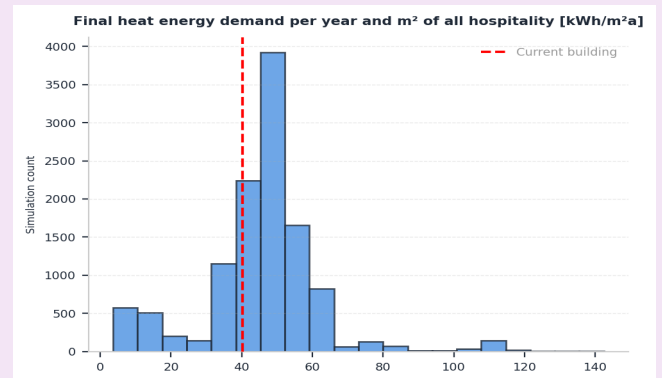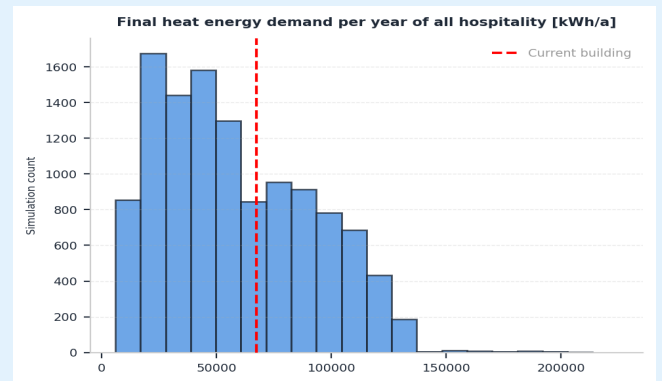







Hospitality Building



Net leased area [m ²]	1688.0
Bldg Height [m]	9.0
Storeys a.g.	2.2
Storeys b.g.	0.5



Building Performance

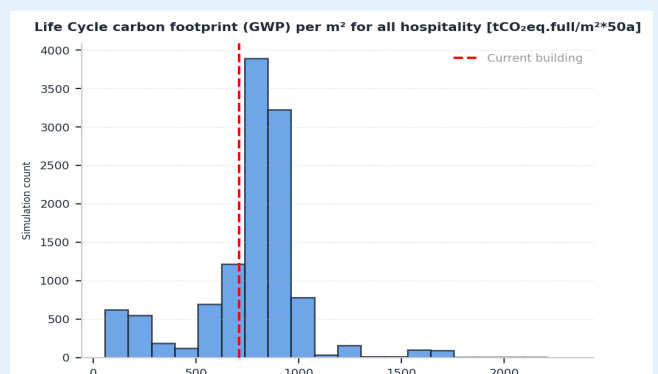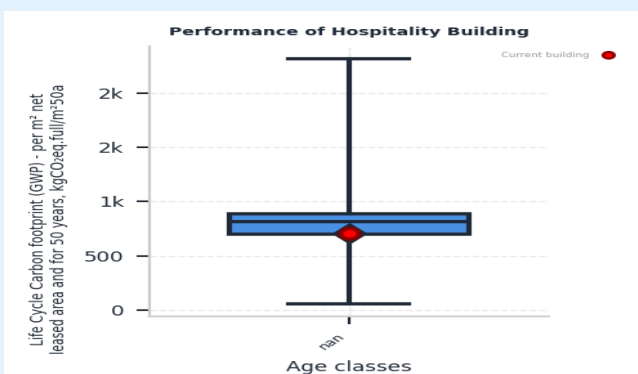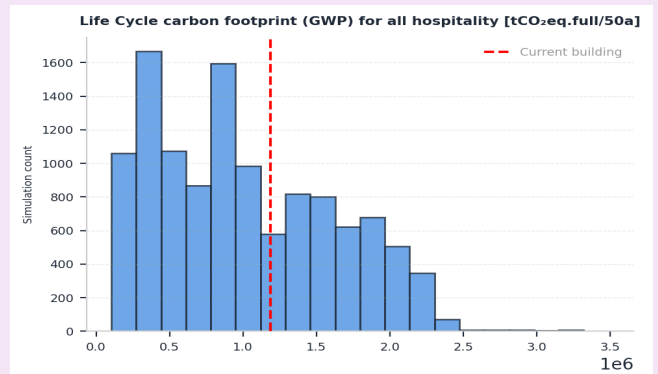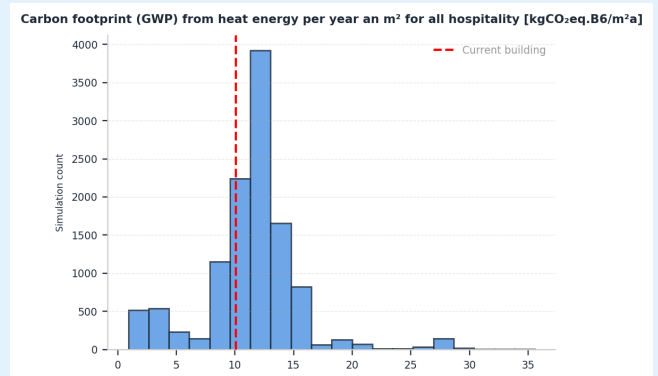



Hospitality Building



Net leased area [m²]	1688.0
Bldg Height [m]	9.0
Storeys a.g.	2.2
Storeys b.g.	0.5



Exterior Wall

Type: massive

U [W/m²K]: 0.23

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	interior plaster	1	1400	0.7	850	7	-
1	precast reinforced concrete	27	2400	2.04	776	8	-
2	mineral wool	6.9	60	0.04	850	4	-
3	resting air layer	6	1.184	0.026	1.005	9	-
4	concrete weather shell	12	2400	2.04	776	8	-

Interior Wall

U [W/m²K]: 4.04

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	lime plaster	1	1600	0.7	850	7	-
1	reinforced concrete	10	2100	2.04	776	8	-
2	lime plaster	1	1600	0.7	850	4	-

Roof

U [W/m²K]: 0.16

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	interior plaster	1	1400	0.7	850	7	-
1	reinforced concrete	22	2400	2.1	776	8	-
2	rafters	8	600	0.13	1500	14	-
3	mineral wool	11.54	60	0.04	850	4	-
4	moving air layer	6	1.184	0.026	1.005	9	-
5	roof tiles	2	1786	0.55	889	10	-



Hospitality Building



Net leased area [m²]	1688.0
Bldg Height [m]	9.0
Storeys a.g.	2.2
Storeys b.g.	0.5



Foundation

U [W/m²K]: 0.77

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	floating cement screed	4	1940	1.4	1000	15	-
1	stone wool	8.86	60	0.09	840	1	-
2	reinforced concrete	15	2104	1.94	776	8	-

Floor

U [W/m²K]: 4.04

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	floating cement screed	4.5	2200	2	1000	15	-
1	EPS_040_15	6	15	0.04	1500	2	-
2	reinforced concrete	16.5	2104	1.94	776	8	-

Window System

Glazing	EPD _{Gl}	Frame type	EPD _{Fr}	Shading type	EPD _{Sh}
2	13	pvc	5	-	-

Heating System

Unit type	Generator	EPD _{HEG}	Heating energy carrier	EPD _{HEC}
per_bldg	ventilation_heating_and_cooling_small	3	R410a	11

HVAC System

Converter	EPD _{HEC}	Ventilation heating	Ventilation cooling	Energy source	EPD _{HES}
boiler_gas_large_condensing	16	yes	no	gas	6



Hospitality Building



Net leased area [m²]	1688.0
Bldg Height [m]	9.0
Storeys a.g.	2.2
Storeys b.g.	0.5




Façade length [m]							
N		S		E		W	
Mean	SE	Mean	SE	Mean	SE	Mean	SE
30.07	7.3	30.18	7.01	25.33	6.29	26.79	6.45

Façade area [m²]							
N		S		E		W	
Mean	SE	Mean	SE	Mean	SE	Mean	SE
339.41	120.54	330.58	112.11	255.06	90.64	266.61	96.85

EPD Summary Table

Serial No.	Full UUID	Material Name
1	155a3b83-ed73-4462-a4f1-69ce64e24981	Mineral wool insulation (high bulk density range)
2	205b761d-e344-49c3-a3a9-bb1bfd59b916	Expanded Polystyrene (EPS) Foam Insulation (density 15 kg/m³)
3	214f9360-6b24-496c-afaa-07348538b790	Ventilation centralized per 5000 m3/h
4	50d421e2-3a7b-4659-92a4-f20d6a52fcf0	Mineral wool (facade insulation)
5	73de9e80-8ed2-47d8-b5b6-854c84166f24	Window sash PVC-U
6	84aa7483-9824-49a9-a3e3-f9fb092ea7b7	Use - 1 kWh of final energy from gas calorific value (according to GEG)
7	9a670d29-efb9-4fde-95ab-182a0b1e7280	Lime gypsum interior plaster
8	Synthetic_2	Concrete C30/37 with reinforcement steel
9	Synthetic_8	Air layer
10	a6d60a75-7a4e-4dfc-87cc-fd40f68d279a	Roofing tiles (including accessories)
11	a9ab7d02-744c-4269-b3e1-a9fc7304e95e	Refrigerant R410a
12	cc071698-9d73-4315-b470-e13dfcdba10a	Chiller (500kW)
13	dcf38066-e336-46a7-b0a8-b2453dd2872d	Window glass, single
14	efa55966-4f29-4f15-bfec-8c08b3945923	Glued laminated timber
15	fe371be5-c72f-4203-8569-a085ef375ba4	CALCIUM SULPHATE FLOWING SCREED AND CONVENTIONAL CALCIUM SULPHATE SCREED
16	fe91b985-60da-45dc-b3fd-29b9e632d49f	Gas condensing boiler120-400 kW (upright unit)

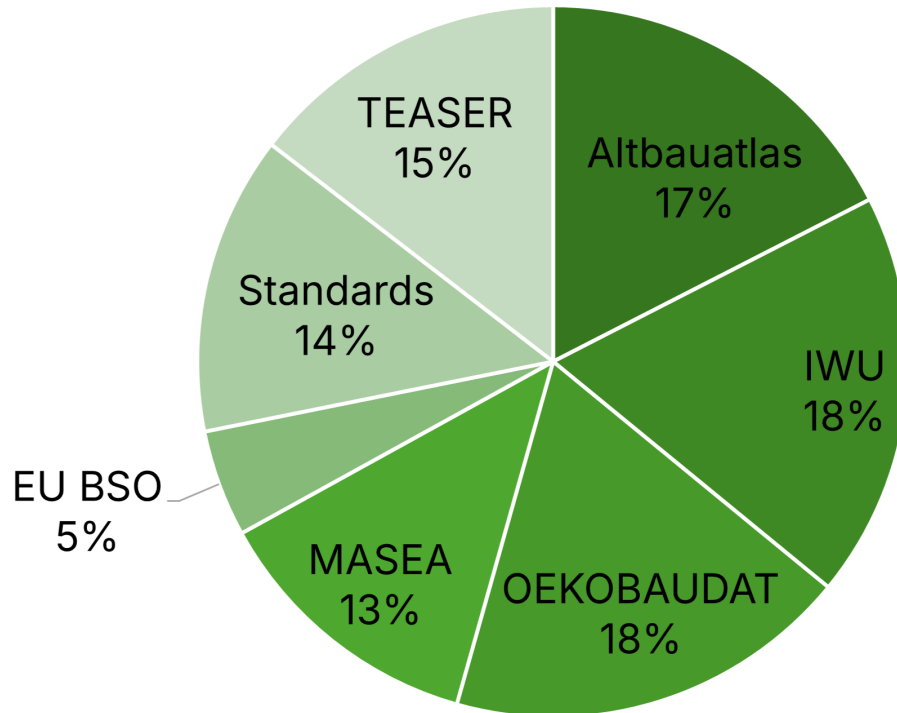

Data source	Link
Altbauatlas	https://www.altbauatlas.de/index.php
OEKOBAUDAT	https://www.oekobaudat.de/en.html
IWU	https://datenbasis.iwu.de/ https://wohngebaeuedaten2016.iwu.de/
MASEA	https://www.masea-ensan.de/
TEASER	https://ebc-tools.eonerc.rwth-aachen.de/en/teaser
EU BSO	https://building-stock-observatory.energy.ec.europa.eu/database/

* Building images are generated by AI