



Office Building





Net leased area [m²]	1743.9
Bldg Height [m]	9.3
Storeys a.g.	2.2
Storeys b.g.	0.5



Building Performance (KPIs)

KPI	Mean	95% CI	Unit	CV	n _{Sim}
Final heat energy demand - per year	72085.72	± 1347.50	kWh/a	0.49	3240
Final heat energy demand - per m² net leased area and year	41.93	± 0.52	kWh/m²a	0.37	3240
Carbon footprint (GWP) from heat energy - per year	18071.27	± 334.77	kgCO ₂ eq,B6/a	0.48	3240
Carbon footprint (GWP) from heat energy - per m² net leased area and year	10.52	± 0.13	kgCO ₂ eq,B6/m²a	0.36	3240
Life Cycle Carbon footprint (GWP) - over 50 years	1286382.25	± 24333.98	kgCO ₂ eq,full/50a	0.50	3240
Life Cycle Carbon footprint (GWP) - per m² net leased area and for 50 years	747.25	± 9.17	kgCO ₂ eq,full/m²50a	0.37	3240

Local Climate Influence



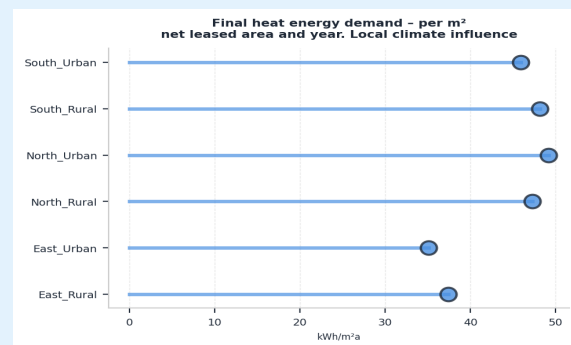
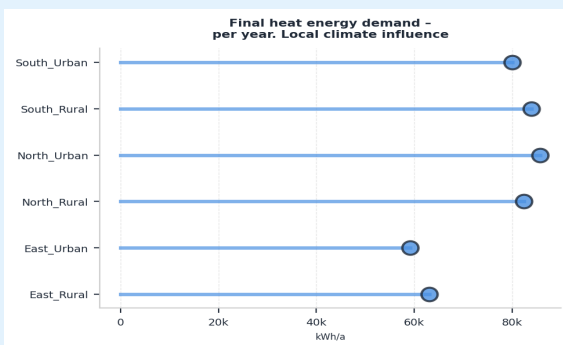




Office Building




Net leased area [m²]	1743.9
Bldg Height [m]	9.3
Storeys a.g.	2.2
Storeys b.g.	0.5

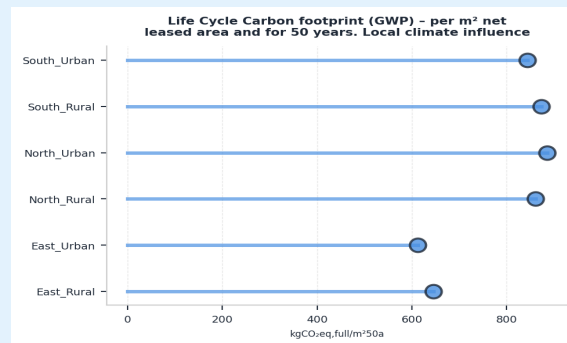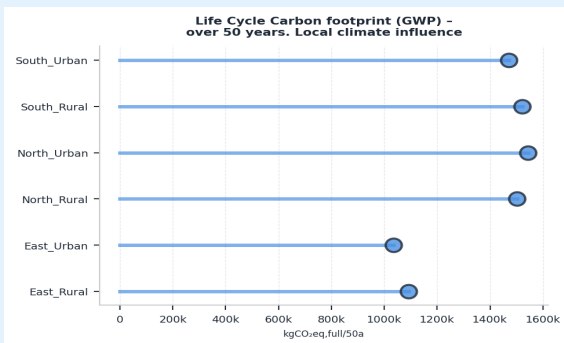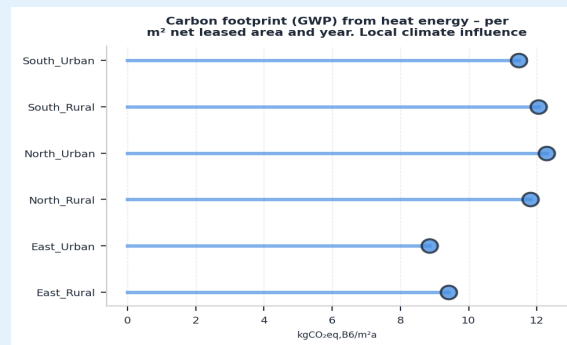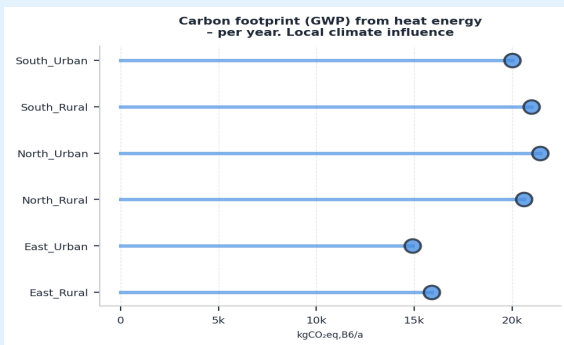

Mean Life Cycle GWP

ABC

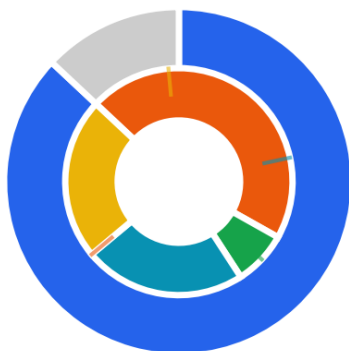

- Operational (87.0%)
- Exterior walls (6.00%)
- Roof (1.00%)
- Foundation (3.00%)
- Windows (3.00%)

Building element	D [kgCO ₂ eq/50a]
Exterior walls	1,525
Roof	-974.3
Foundation	585.4
Windows	-8,863









Office Building



Net leased area [m ²]	1743.9
Bldg Height [m]	9.3
Storeys a.g.	2.2
Storeys b.g.	0.5



Building Performance

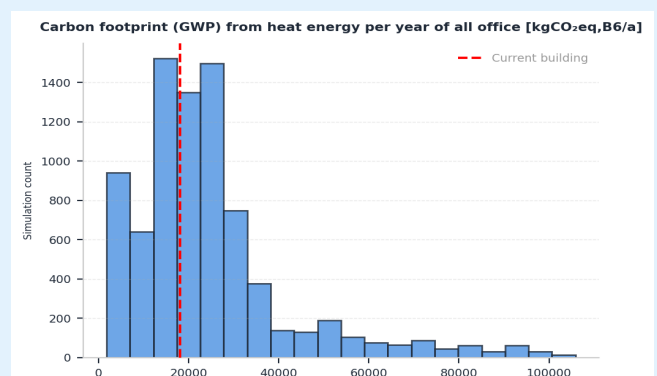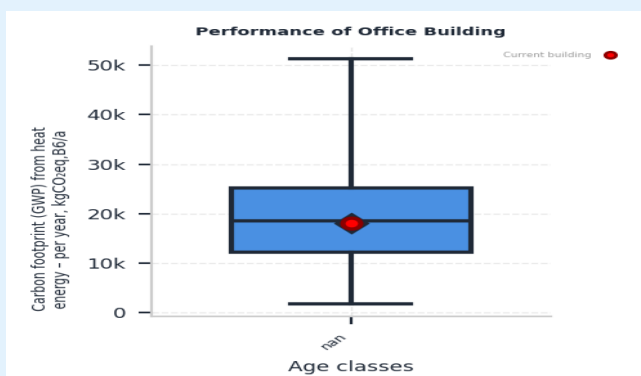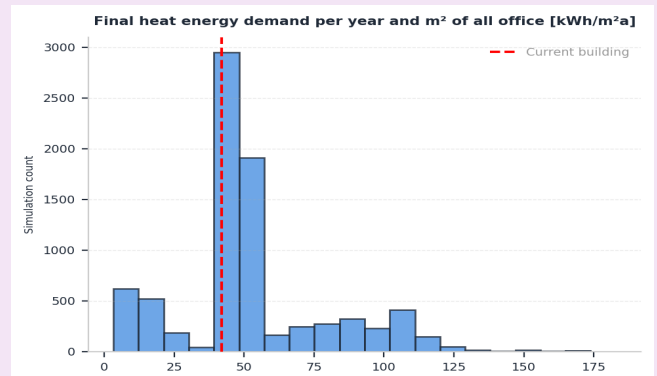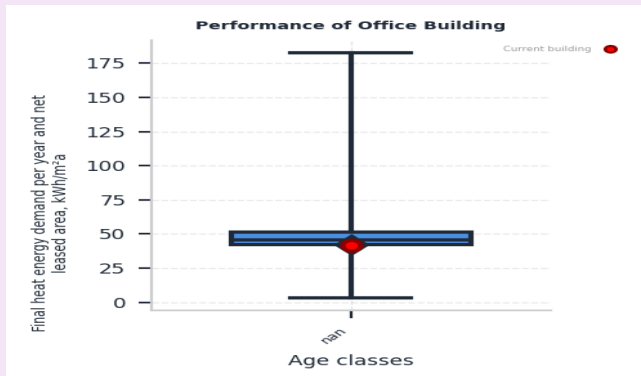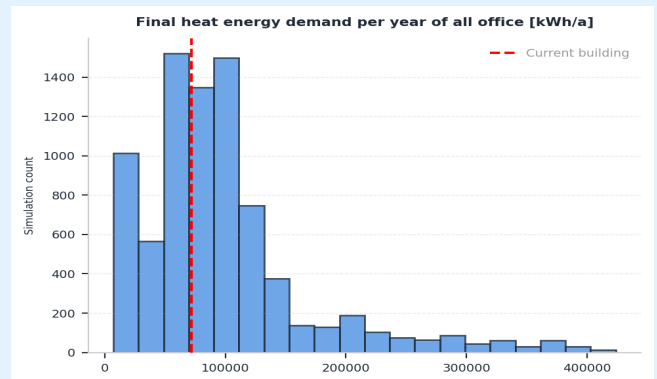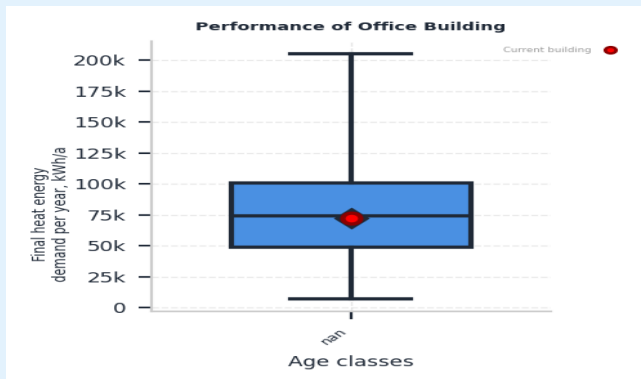









Office Building



Net leased area [m ²]	1743.9
Bldg Height [m]	9.3
Storeys a.g.	2.2
Storeys b.g.	0.5



Building Performance

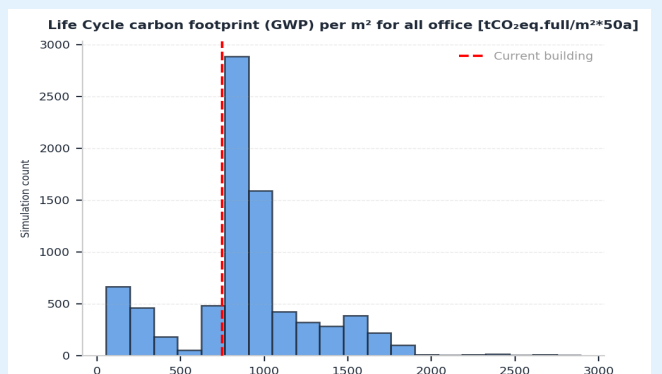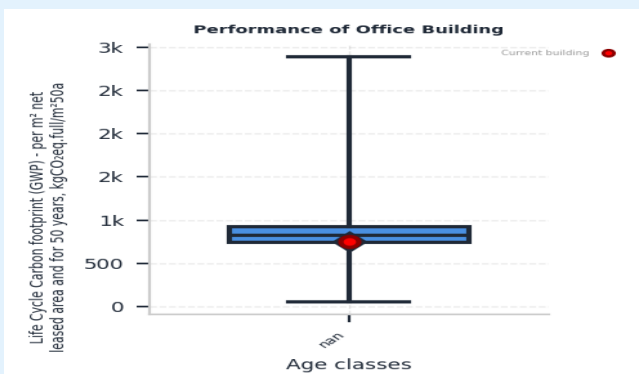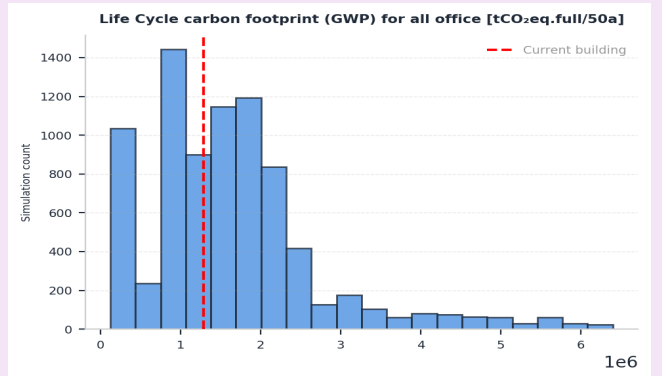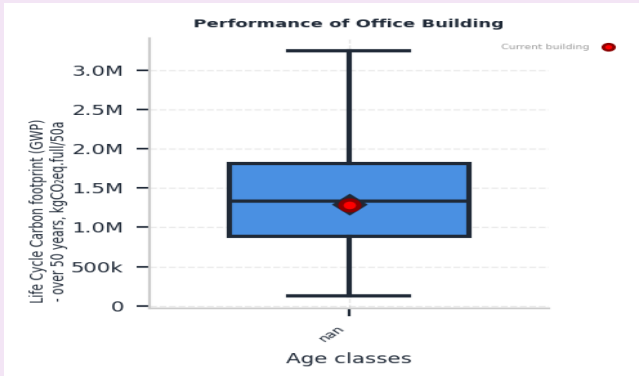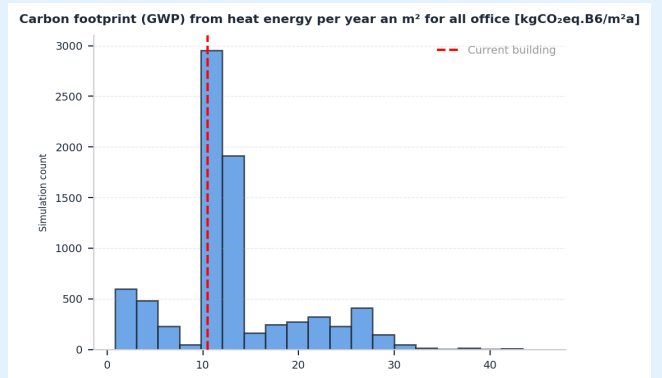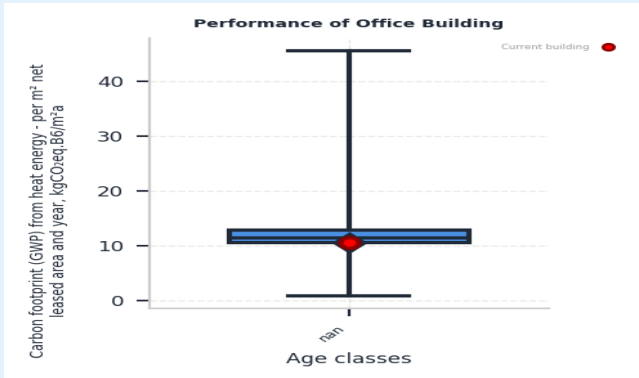



Office Building



Net leased area [m²]	1743.9
Bldg Height [m]	9.3
Storeys a.g.	2.2
Storeys b.g.	0.5



Exterior Wall

Type: massive

U [W/m²K]: 0.25

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	interior plaster	1	1400	0.7	850	5	-
1	precast reinforced concrete	29.875	2400	2.04	776	6	-
2	mineral wool	4.95	60	0.04	850	3	-
3	resting air layer	6	1.184	0.026	1.005	7	-
4	concrete weather shell	12	2400	2.04	776	6	-

Interior Wall

U [W/m²K]: 4.04

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	lime plaster	1	1600	0.7	850	5	-
1	reinforced concrete	10	2100	2.04	776	6	-
2	lime plaster	1	1600	0.7	850	3	-

Roof

U [W/m²K]: 0.16

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	interior plaster	1	1400	0.7	850	5	-
1	reinforced concrete	25.5	2400	2.1	776	6	-
2	rafters	8	600	0.13	1500	11	-
3	mineral wool	12.22	60	0.04	850	3	-
4	moving air layer	6	1.184	0.026	1.005	7	-
5	roof tiles	2	1786	0.55	889	8	-



Office Building



Net leased area [m²]	1743.9
Bldg Height [m]	9.3
Storeys a.g.	2.2
Storeys b.g.	0.5



Foundation

U [W/m²K]: 0.73

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	floating cement screed	4	1940	1.4	1000	12	-
1	stone wool	9.37	60	0.09	840	1	-
2	reinforced concrete	18.5	2104	1.94	776	6	-

Floor

U [W/m²K]: 4.04

Layer	Material Name	t_i [cm]	ρ_i [kg/m³]	λ_i [W/mK]	c_i [J/kgK]	EPD ₁	EPD ₂
0	floating cement screed	4.5	2200	2	1000	12	-
1	EPS_040_15	6	15	0.04	1500	2	-
2	reinforced concrete	20.688	2104	1.94	776	6	-

Window System

Glazing	EPD _{Gl}	Frame type	EPD _{Fr}	Shading type	EPD _{Sh}
2	10	aluminium	9	-	-

Heating System

Unit type	Generator	EPD _{HEG}	Heating energy carrier	EPD _{HEC}
per_bldg	boiler_gas_large_condensing	13	gas	4



Office Building



Net leased area [m²]	1743.9
Bldg Height [m]	9.3
Storeys a.g.	2.2
Storeys b.g.	0.5




Façade length [m]							
N		S		E		W	
Mean	SE	Mean	SE	Mean	SE	Mean	SE
25.67	6.62	27.08	6.53	26.56	5.49	26.68	5.82

Façade area [m²]							
N		S		E		W	
Mean	SE	Mean	SE	Mean	SE	Mean	SE
279.75	89.95	290.31	89.64	271.57	65.24	271.99	68.76

EPD Summary Table

Serial No.	Full UUID	Material Name
1	155a3b83-ed73-4462-a4f1-69ce64e24981	Mineral wool insulation (high bulk density range)
2	205b761d-e344-49c3-a3a9-bb1bfd59b916	Expanded Polystyrene (EPS) Foam Insulation (density 15 kg/m³)
3	50d421e2-3a7b-4659-92a4-f20d6a52fcf0	Mineral wool (facade insulation)
4	84aa7483-9824-49a9-a3e3-f9fb092ea7b7	Use - 1 kWh of final energy from gas calorific value (according to GEG)
5	9a670d29-efb9-4fde-95ab-182a0b1e7280	Lime gypsum interior plaster
6	Synthetic_2	Concrete C30/37 with reinforcement steel
7	Synthetic_8	Air layer
8	a6d60a75-7a4e-4dfc-87cc-fd40f68d279a	Roofing tiles (including accessories)
9	d0e0f205-2f4d-4c7f-b63a-23a9abd6e60a	Aluminium frame profile, powder coated
10	dcf38066-e336-46a7-b0a8-b2453dd2872d	Window glass, single
11	efa55966-4f29-4f15-bfec-8c08b3945923	Glued laminated timber
12	fe371be5-c72f-4203-8569-a085ef375ba4	CALCIUM SULPHATE FLOWING SCREED AND CONVENTIONAL CALCIUM SULPHATE SCREED
13	fe91b985-60da-45dc-b3fd-29b9e632d49f	Gas condensing boiler120-400 kW (upright unit)

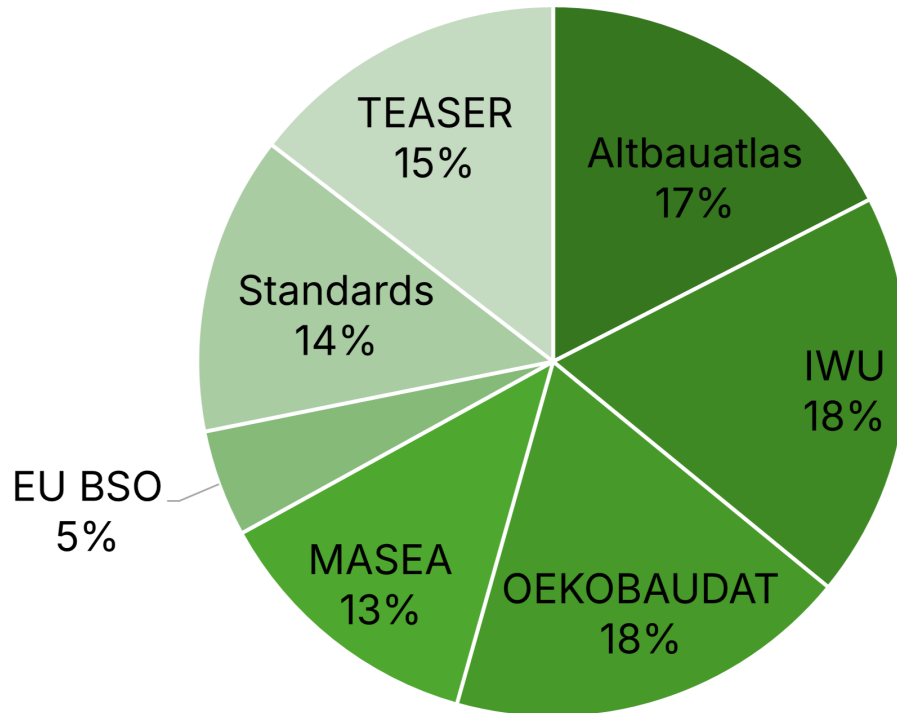

Data source	Link
Altbauatlas	https://www.altbauatlas.de/index.php
OEKOBAUDAT	https://www.oekobaudat.de/en.html
IWU	https://datenbasis.iwu.de/ https://wohngebaeuedaten2016.iwu.de/
MASEA	https://www.masea-ensan.de/
TEASER	https://ebc-tools.eonerc.rwth-aachen.de/en/teaser
EU BSO	https://building-stock-observatory.energy.ec.europa.eu/database/

* Building images are generated by AI